



CB120W CB240W CB480W: Smart Battery Chargers
Thank you for having chosen one of our products for your work.
We are certain that it will give the utmost satisfaction and be a helpful help on the job.



General Description

The CB series is a "Switching technology" and "Battery Care philosophy" since many years parts of the know-how ADEL system, led to the development of this advanced multi-stage battery charging, completely automatic and suited to meet the most advanced requirements of battery manufacturers. The Battery Care concept is based on algorithms that implement rapid and automatic cycle of battery charging, battery charge optimization during time, flat batteries recovery and real time diagnostic during installation and operation. The Real Time Auto-diagnostic system, monitoring battery faults such as, elements in short circuit, accidental reverse polarity connection, disconnection of the battery, they can easily be detected and removed by help of Blink Code of Diagnosis Led; during the installation and after sell. Each device is suited for all battery types, jumper selection sets a predefined curves for: Open Lead Acid, Sealed Lead Acid, Gel, Ni-Cd and Ni-Mh. A rugged casing with bracket for DIN rail mounting provide IP20 protection degree.



Main Characteristics


- Input: Single-phase 115 – 230 – 277 Vac
- Output Battery: charging: 24 Vdc 10A – 20 A
12 Vdc 10A – 35 A;
- Suited for the following battery types: Open Lead Acid, Sealed Lead Acid, Lead Gel, Ni-Cd and Ni-Mh
- Automatic diagnostic of battery status. Charging curve IUUO, constant voltage and constant current Battery Life Test function (Battery Care)
- Switching technology-
- Three charging levels: Boost, Trickle and Recovery
- Protected against short circuit, Over Load and inverted polarity
- Signal output (contact free) for discharged or damaged battery
- Signal output (contact free) for Mains or Back-Up
- Protection degree IP20 - DIN rail; Space saving

Safety and warning notes
WARNING – Explosion Hazard Do not disconnect Equipment unless power has been switched off or the area is known to be non-hazardous.
WARNING – Explosion Hazard. Substitution of components may impair suitability for class I, Division 2.
WARNING – Switch off the system before connecting the module. Never work on the machine when it is live. The device must be installed in accordance with UL508. The device must have a suitable isolating facility outside the power supply unit, via which can be switched to idle. Danger of fatal Injury!

Connection (terminal and wiring):


Cable Connection: The following cable cross-sections may be used:

Solid (mm²)	Stranded (mm²)	AWG	Torque (Nm)	Stripping Length	All In One (Size)
0.2 – 2.5	0.2 – 2.5	24 – 14	0.5 – 0.6	7 mm	Size 1 and 2
In: 4.0	6.0	30 – 10	0.8 – 1.0	7 mm	Size 3
Out: 4.0	6.0	24 – 14	0.5 – 0.6	7 mm	Size 1 and 2
Signal: 0.2 – 2.5	0.2 – 2.5	24 – 14	0.5 – 0.6	7 mm	All types



The connection is made by the screw type 2.5 mm² or 4.0 mm² (CB2420A – CB1235A) terminal blocks. Use only copper cables that are designed for operating temperatures of > 75 °C. Wiring terminal shall be marked to indicate the proper connection for the power supply. Output Power connections:

Output Power Connections:




Normal connection


Typical application for CBxxx device:
N°1 battery (12 Vdc) for CB12yy;
N°2 battery (12 Vdc) connected in Series for CB24yy;

"Redundancy" Connection

It's possible to request the Redundancy option for the model CB2420AR. Just connect the two CB via the RJ45 cable to AUX2 and power on them (also at different times), automatically one of the CB becomes the real battery charger (indicated by a flashing LED diagnosis according to the usual frequency) while the second holds steady on the LED diagnosis. On both pieces is active the management of alarms. If the piece that charge turns off (or break!) the second automatically begins charging. If there is no communication between the two CB has alarm with flash = code 11 blinks, under these conditions both the CB trying to charge the battery (situation not recommended) to which it is appropriate to human intervention, just reconnect the two pieces and the situation normalizes.

Operating and Display Element:

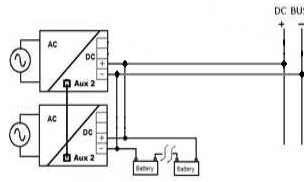



No. 10: Input AC Port pin. L – N:
1 Phase Switching Power Supplies L, N, PE @.
Size 2 and Size 3 BRIDGE ONLY for input 115 Vac, and connect L, N, PE @.

No. 3: Battery Connection Port:
Connect the battery between pin. 3 (–) and 4 (+)
One battery (12 Vdc) for CB12yy;
Two battery (12 Vdc) connected in Series for CB24yy;

No. 1, 2 Signal Ports (output Isolated):
Connections for,
No. 2: Mains/Back Up: Input Mains On/Off. Contact: 5,6,7
No. 1: Low Battery, Fault connections systems, Battery replacement. Contact: 8,9,10
Relay Contact Rating:
Max.DC1: 30 Vdc 1 A; AC1: 60 Vac 1 A : Resistive load (EN 60947-4-1)
Min.1mA at 5 Vdc: Min. permissive load

Signal Output port true table:	Port N°2 - Led N°6 Mains/Back-Up		Port N°1 - Led N°7 Fault Battery	
	5-6 Closed	5-7 Closed	8-9 Closed (OK)	8-10 Closed
Mains Input Vac	ON OFF	■ - led off ■ - led On (1)	■ - led off ■ - led off	
The battery in BackUP it is less than 30% cap?	YES NO	■ - led On ■ - led On	■ - led off	■ - led On
Battery or system Fault?	YES NO	■ - led off ■ - led off	■ - led off	■ - led On (2)


Note:(1) For better efficiency of the system, filter relay Mains/Back up with a delay of at least 5 seconds before give alarm Main Lost, example: connection to PLC.
(2) See Diagnosis Led

Monitoring Control Chart:	State	LED Diagnosis (No.8)	LED Battery Fault (No.7)
Charging Type	Trickle	1 Blink/sec	OFF
	Boost	2 Blink/sec	OFF
	Recovery	5 Blink/sec	OFF
Auto diagnosis of the system	Reverse polarity or high battery Voltage (over 32.5Vdc for CB24xx)	1 Blink/pause 1	ON
	Battery No connected	2 Blink/pause 1	ON
	Element in Short Circuit	3 Blink/pause 1	ON
	Bad battery; Internal impedance Bad or Bad battery wire connection.	5 Blink/pause 1	ON
	Life test not possible	6 Blink/pause 1	ON
	Bad thermal sensor	7 Blink/pause 1	ON
	Internal fault	9 Blink/pause 1	ON
Only for CB Size 3	CAN bus error	11 Blink/pause 1	
	Life test not possible; Parallel mode on Slave Device	12 Blink/pause 1	
	Bad battery wire connection; Parallel mode on Slave Device	13 Blink/pause 1	

No. 12: Battery Management Configurations
Preliminary Operations: One device for all battery types.
Completely automatic, all devices are suitable to charge most batteries types thank to User Selectable charging curves. They can charge open lead acid, sealed lead acid, Gel and Ni-Cd, Ni-MH batteries. It is possible to change or add other charging curves connecting the device to a portable PC.
Caution: Switch off the system before Setting the jumper.

Battery Type Selection	Jumper Position (Size 1)	Jumper Position (Size 2)	Jumper Position (Size 3)	Trickle/Float at charge (Volt/Cell)	Fast/Bulk charge (Volt/Cell)
Open Lead				2.23	2.40
AGM Low				2.25	2.40
AGM High				2.27	2.40
Gel Battery				2.30	2.40
Battery Type Selection (NiCd)	Jumper Position (Size 1)	Jumper Position (Size 2)	Jumper Position (Size 3)	Trickle/Float charge	Fast/Bulk charge
Open Lead				2.23	2.40
(AGM) Low				2.25	2.40
Gel Battery				2.30	2.40
NiCd				1.4V/cell (12V-10 cells) 2.4V-20 cells (24V-20 cells) 4.8V-40 cells	1.5V/cell (12V-10 cells) 2.4V-20 cells (24V-20 cells) 4.8V-40 cells
Functional Setting				Function	
Battery Life test ON				Jumper present: Life test enabled.	
Fast Charge Enable				Jumper present: Fast Charge enabled.	
Fast Recovery Charge				Possibility to recharge the battery also when the voltage is close to Zero with the maximum power of the device.	


No. 5: Charging Level Current:



It is possible set the max recharging current for the batteries by trimmer (Charging Level). The current adjustment goes from 10% + 100% of In. Set the maximum charging current between 10% and 20% of the battery capacity.

No. 11: Auxiliary Output
RJ 45 behind the label in SIZE 1 and SIZE 3; remove the window label to find the connector, For SIZE 2: CB2410 require /ARJ code for RJ45 connector.
It is possible connect:

- Temperature sensor, for ambient temperature charging compensation. With this it is possible to activate the specifications of the EN54-4 firing norm.
- Connection for external display to remote N° 3 led of the internal device.



No. 14: Auxiliary Output "Aux 2"
Present only in CB2420A and CB1235A it is provided of CAN2.0A connection.
Connection for external Intelligent display.

Battery Care
The Battery Care philosophy is based on algorithms that implement rapid and automatic charging, battery charge optimization during time, flat batteries recovery and real time diagnostic during installation and operation. The Real Time Auto-diagnostic system, monitoring battery faults such as, elements in short circuit, accidental reverse polarity connection, disconnection of the battery, they can easily be detected and removed by help of Blink Code of Diagnosis Led; during the installation and after sell. Each device is suited for all battery types, by means of jumpers it is possible setting predefined curves for Open Lead Acid, Sealed Lead Acid, Gel, Ni-Cd and Ni-Mh (option). They guarantee battery reliability in time by continuously testing the internal impedance status, avoids any possible risk of damages and grants also a permanent, reliable and safe connection of the battery to the power supply. The system, through a battery stimulation circuit with algorithms of evaluation of the detected parameter, is able to recognize sulphated batteries or batteries with a short-circuited element.
Battery Test: Automatic. Every 60 sec. check battery connection. Every 220 minute in trickle charge, make the test of the battery efficiency. The fault is signaled with relay commutation and diagnosis led blinking.


Diagnostic Type Checks:
Check for accidental disconnection of the battery cables:
CBxxx detects accidental disconnection.
Battery not connected:
CBxxx detects if the battery is not connected.
Test of quality wire connections:
During trickle charge the quality (resistance) on the battery connection is checked every 20 sec. This to detect if the cable connection has been properly made.
Battery in Open Circuit or Sulphated:
Every 220 minute CBxxx tests the internal impedance, in trickle charging mode.
Reverse Polarity check:
If the battery it is connected with inverted polarity, CBxxx is automatically protected.
Test of battery voltage connections:
Appropriate voltage check, to prevent connection of wrong battery types, more or less than the nominal voltage.
End of Charge check
When the battery it is completely full, the device automatically switch in trickle charging mode.
Check for Battery Cells in short circuit
Thanks to specific algorithms of evaluation, the CBxxx recognize batteries with cells in internal short circuit. In trickle charge every 2 hours test of element in short circuit.
Diagnosis of battery and device
All CBxxx devices support the user during installation and operation. A Blink code of Diagnosis Led allows to discriminate among various possible faults.
Error conditions, "LED Battery Fault" ON and "LED Diagnosis" blinking with sequence; see Display Signal section.

Charging Curve

Automatic multi-stage operation and real time diagnostic allows fast recharge and recovery of deep discharged batteries, adding value and reliability to the system hosting the CBxxyy device. The type of charging is Voltages stabilized and Current stabilized IUoUo.

Three charging modes are identified by a flashing code on a Diagnosis LED.

	State	Diagnosis LED	Battery Fault LED
Charging Type	Trickle	1 Blink/sec	OFF
	Boost	2 Blink/sec	OFF
	Recovery	5 Blink/sec	OFF

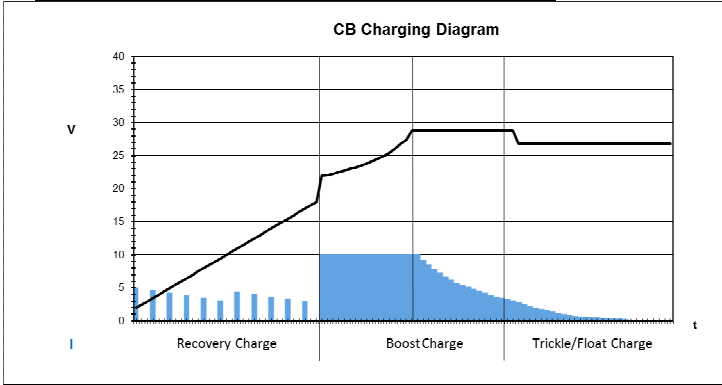

Compensation Recharges in temperature

(For SIZE 2: CB2410 require /ARJ code)
Connecting to RJ45 Auxiliary Output the cable RJTEMP (supplied separately), the CB will vary the voltage of battery charging in depending of the temperature:

Fast Charge	Trickle charge
+/-5mV/°C x n. of Cells from -8°C to +60°C +140mV/Cell ÷ -200mV/Cell compared to the value at 20°C	+/-3mV/°C x n. of Cells from -20°C to +60°C +120mV/Cell ÷ -120mV/Cell compared to the value at 20°C

If the temperature is less than -20°C or greater than +60°C alarm is signalled with code 7 blink.
The sensor place on cable RJTEMP must be applied on the battery.
If the sensor is not connected or if the sensor is defective, the led Low Batt is on and the led Diagnosis continues to show the status of the battery: trickle charge, fast charge or recovery charge.

Protection Features

On the primary side: the device is equipped whit an internal fuse. If the internal fuse is activated, it is most probable that there is a fault in the device. If happen, the device must be checked in the factory.

On the secondary side Battery: The device is electrically protected against short circuits and overload.
Inversion polarity: the module it is automatically protected against inversion of battery polarity.
Deep discharge : not possible. The unit disconnects the battery when a minimum voltage level is reached.

Thermal behaviour

Surrounding air temperature 50°C. For ambient temperature of over 50°C, the output current must be reduced by 2.5% per °C. Max 70°C At the temperature of 70°C the output current will be 50% of In. The equipment does not switch off in case of ambient temperature above 70°C or thermal overload. The devices are protected for Over temperature conditions "worst case"; in this situations the device Shut-down the output and automatic restart when temperature inside fall.


Standards and Certification







Electrical Safety:
Assembling device: UL508, IEC/EN 60950 (VDE 0805) and EN 50178 (VDE 0160).
Installation according: IEC/EN 60950.
Input / Output separation: SELV EN 60950-1 and PELV EN 60204-1. Double or reinforced insulation.
EMC Standards Immunity:
EN 61000-4-2, EN 61000-4-3, EN 61000-4-4, EN 61000-4-5.
EMC Standards Emission:
EN 61000-6-4, EN 61000-6-3, EN 61000-3-2 (see data sheet for each device)
Standards Conformity:
Safety of Electrical Equipment Machines: EN 60204-1.
CE The CE mark in According to EMC 2014/30/UE and Low voltage directive 2014/35/UE

Norms and Certifications

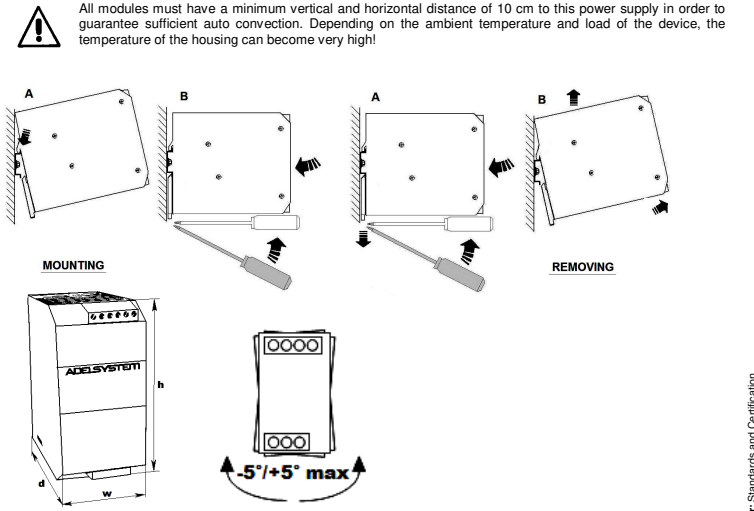In Conformity to: IEC/EN 60335-2-29 Battery chargers; EN60950 / UL1950; Electrical safety EN54-4 Fire Detection and fire alarm systems: 2014/30/UE EMC Directive; 2014/35/UE (Low Voltage); DIN41773 (Charging cycle); Emission: IEC 61000-6-4; Immunity: IEC 61000-6-2. CE.

Rail Mounting:



CB Battery Charger					
					
Input (Volt)	115 – 230 – 277Vac	115 – 230 – 277Vac	115 – 230 – 277Vac	115 – 230 – 277Vac	
Output (Vdc – A – W)	12Vdc – 10A – 120W	12Vdc – 35A – 480W	24Vdc – 10A – 240W	24Vdc – 20A – 480W	
Model	CB1210A	CB1235A	CB2410AC	CB2420A	
INPUT DATA					
Nominal Input Voltage / Tensione d'ingresso nominale	115 – 230 – 277Vac	115 – 230 – 277Vac	115 – 230 – 277Vac	115 – 230 – 277Vac	
Input Voltage Range / Campo di funzionamento	90 – 305Vac	90 – 135Vac 180 – 305Vac	90 – 135Vac 180 – 305Vac	90 – 135Vac 180 – 305Vac	
Inrush Current (Vn and In Load) I ² t / Corrente di Inserzione	≤ 16 A ≤ 5msec	≤ 35 A ≤ 5msec	≤ 16 A ≤ 5msec	≤ 35 A ≤ 5msec	
Frequency /Frequenza di Ingresso	47 – 63 Hz ±6%	47 – 63 Hz ±6%	47 – 63 Hz ±6%	47 – 63 Hz ±6%	
Input Current (115 – 230Vac) / Assorbimento	2.4 – 1.2A	8.0 – 4.2A	3.3 – 2.2A	8.0 – 4.2A	
Internal Fuse / Fusibile Interno (non sostituibile)	4A	10A	6.3A	10A	
External Fuse (recommended)/ Fusibile Esterno raccomandato	10A	16A	16A	16A	
OUTPUT DATA					
Output Vdc / I _N / Tensione di uscita Vdc / I _N	12Vdc – 10A	12Vdc – 35A	24Vdc – 10A	24Vdc – 20A	
Minimum load / Carico minimo	No	No	No	No	
Efficiency (50% of In) / Rendimento tipico	≥ 89%	≥ 91%	≥ 88%	≥ 91%	
Short-circuit protection / Protezione contro il corto circuito	Yes	Yes	Yes	Yes	
Over Load protection / Protezione sovraccarico	Yes	Yes	Yes	Yes	
Over Voltage Output protection / Protezione sovratensione in uscita	Yes	Yes	Yes	Yes	
Reverse battery protection / Protezione inversione batteria	Yes	Yes	Yes	Yes	
Detection of element in short circuit / Relevazione elemento in corto circuito	Yes	Yes	Yes	Yes	
BATTERY CHARGER OUTPUT / USCITA CARICA BATTERIA					
Boost – Bulk charge (Typ. at I _N) / Carica Veloce (1)	14.4Vdc	14.4Vdc	28.8Vdc	28.8Vdc	
Max.Time Boost–Bulk charge (Typ. at I _N) / Tempo massimo Carica Veloce	15h	15h	15h	15h	
Min.Time Boost–Bulk charge (Typ. at I _N) / Tempo minimo Carica Veloce	1min.	1min.	1min.	1min.	
Trickle-Float charge (Typ. at I _N) / Carica di mantenimento (1)	13.75Vdc	13.75Vdc	27.5Vdc	27.5Vdc	
Recovery Charge / Carica di recupero	2 – 9Vdc	2 – 9Vdc	2 – 18Vdc	2 – 18Vdc	
Switching on after applying mains voltage	2.5sec.		2.5sec.		
End of charging current Bulk - Absorption to Float - Trickle	0.3A		0.3A		
Start up with capacitive load / Start up con carichi capacitivi	≤ 30.000µF		≤ 30.000µF		
Residual Ripple / Ripple Residuo	≤ 60 mVpp		≤ 60 mVpp		
Charging max I _{batt} / Corrente max. di Carica	10A ± 5%	35A ± 5%	10A ± 5%	20A ± 5%	
Charging current Limiting I _N (I _{adj}) / Limitazione Corrente di Carica	Yes	Yes	Yes	Yes	
Quieshent Current / Consumo da batteria max.	≤100mA	≤100mA	≤100mA	≤100mA	
SIGNAL OUTPUT (RELAY) / SEGNALE USCITA					
Main or Backup Power	Yes	Yes	Yes	Yes	
Low Battery and Fault Battery	Yes	Yes	Yes	Yes	
Main or Backup - Fault Battery	No	No	No	No	
AUXILIARY OUTPUT (RJ 45 CONNECTION) FOR:					
Temp. Charging probe / Carica Compensata in Temperatura	Yes	Yes	Yes	Yes	
Voltage drop compensation / Comp. Tensione di ricarica	Yes	Yes	Yes	Yes	
Remote monitoring display / Display Esterno	Yes	Yes	Yes	Yes	
CLIMATIC DATA					
Ambient Temperature operation / Temperatura Ambiente di Lavoro	-30 – +70°C	-30 – +70°C	-30 – +70°C	-30 – +70°C	
De rating T ^a > (In) / De rating T ^a > (In)	> 50° 2.5% °C	> 50° 2.5% °C	> 50° 2.5% °C	> 50° 2.5% °C	
Automatic De rating / De rating Automatico	No	No	No	No	
De rating at 115Vac / De rating a 115Vac					
Ambient Temperature Storage / Temperatura max. Magazzino	-40 – +85°C	-40 – +85°C	-40 – +85°C	-40 – +85°C	
Humidity at 25 °C / Umidità	95% to 25°C	95% to 25°C	95% to 25°C	95% to 25°C	
Cooling / Raffreddamento					
GENERAL DATA					
Isolation Voltage (IN / OUT) / Tensione di Isolamento (IN / OUT)	3000Vac	3000Vac	3000Vac	3000Vac	
Isolation Voltage(IN / PE) / Tensione di Isolamento(IN / TERRA)	1605Vac	1605Vac	1605Vac	1605Vac	
Isolation Voltage(OUT / PE) / Tensione di Isolamento(OUT/TERRA)	500Vac	500Vac	500Vac	500Vac	
Protection Class (EN/IEC 60529) / Protezione Classe	IP 20	IP 20	IP 20	IP 20	
Reliability (MTBF IEC 61709) / Affidabilità	> 300 000 h	> 300 000 h	> 300 000 h	> 300 000 h	
Pollution Degree Environment / Grado d'inquinamento ambientale	2	2	2	2	
Connection Terminal Blocks Screw Type / Dimensione morsetti	2,5mm	4mm	2,5mm	4mm	
Protection class (with PE connected) / Grado di protezione (con cavo di terra collegato)	I	I	I	I	
Dimension (w-h-d)/Dimensioni (l-h-p) mm	65x115x135 mm	150x115x135 mm	100x115x135 mm	150x115x135 mm	
Weight / Peso	0.65 kg approx	1.5 kg approx	0.85 kg approx	1.5 kg approx	
Safety Standard Approval / Conformità ed Approvazioni	CE	CE	CE	CE	
CONNECTION DIAGRAM / SCHEMA DI CONNESSIONE					

(1) - Depend on jumper selection